

Operation Instructions

ENG

Control Stations

FXL****.CS / XL****.CS / GL***.CS

Pepperl+Fuchs GmbH
Lilienthalstrasse 200
68307 Mannheim, Germany
Tel. +49 621 776-0
Fax +49 621 776-1000

Part No.:
Document No.:
Edition: 08/2014

Copyright Pepperl+Fuchs
www.pepperl-fuchs.com

 **PEPPERL+FUCHS**

Validity

Specific processes and instructions in this document require special precautions to guarantee the safety of the operating personnel.

Target Group/Personnel

Responsibility for planning, assembly, commissioning, operation, maintenance, and dismounting lies with the system operator.

Mounting, installation, commissioning, operation, maintenance and disassembly of any devices may only be carried out by trained, qualified personnel. The instruction manual must be read and understood.

Laws, standards, or directives applicable to the intended use must be observed. In relation to hazardous areas, Directive 1999/92/EC must be observed.

The corresponding data sheets, declarations of conformity, EC-type-examination certificates, certificates and Control Drawings if applicable (see data sheet) are an integral part of this document. You can find this information under www.pepperl-fuchs.com.

Mounting/Installation

- Use only one conductor per terminal.
- If cable glands are needed for installation, the following points must be considered / evaluated:
 - The cable glands used must be suitably certified for the application
 - The temperature range of the cable glands must be chosen according to the application.
 - The cable glands fitted must not reduce the IP rating.
- If you use stranded wires, crimp on wire end ferrules.

In order to guarantee the temperature classes, ensure that power dissipation is lower than the figure stated in the certificate. Most of the power dissipation arises from current flowing in the cables.

In order to minimize power dissipation, observe the maximum possible cable lengths.

Observe the tightening torque of the terminal screws.

Unused conductors must be either connected to terminals or securely tied down and isolated.

If mounting the enclosure on concrete use expanding bolts. If mounting the enclosure to a steel framework use vibration resistant mounting equipment.

The insulation stripping length must be considered.

To ensure the IP degree of protection:

- all seals must be undamaged and correctly fitted
- all screws of the surrounding enclosure and its cover must be tightened with the appropriate torque
- only cable of the appropriate size must be used in the cable glands
- all cable glands must be tightened with the appropriate torque
- all empty cable glands must be sealed with the corresponding plugs

When installing additional components, make sure that these components are listed in the EC-Type-Examination Certificate of the control station.

Select suitable conductors in order to ensure, that the maximum permitted temperature of the conductors fit to the maximum permitted ambient temperature of the control station.

The permitted ambient temperatures of the built-in components must not be exceeded.

The minimum bending radius has to be adhered to.

When installing the conductors the insulation must reach up to the terminal. In order to prevent condensation in the enclosure, use suitable certified breathers.


Connect all bare non-energized metal parts to the protective earth conductor. Observe IEC/EN 60079-17 for maintenance and testing.

Before opening the enclosure make sure, that the built-in components are de-energized.

When energized, the enclosure may only be opened for maintenance, if only intrinsically safe circuits are used inside the enclosure.

If there is a defect, the product must be repaired by Pepperl+Fuchs.

When the internal/external ground bolt is supplied loose, the components should be fitted as shown in the figure below.

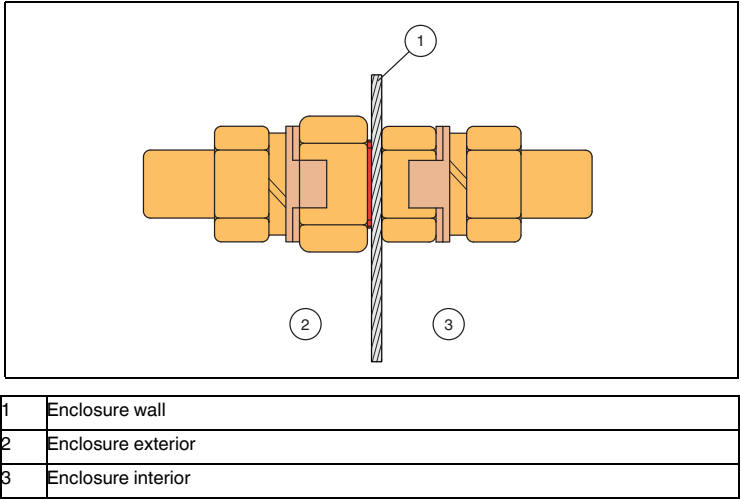

Technical Specifications

(F)XL*****.CS (formerly .CP)		Refer to type code builder in chapter „Typecodes“
GL*****.CS (formerly .CP)		Refer to type code builder in chapter „Typecodes“
Hazardous Area		
ATEX certificate number		SIRA13ATEX3059X
IECEx certificate number		IECEx SIR 13.0021 (no IECEx for Control Stations fitted with Schmersal controls)
CE number		 0102
Certification coding for ATEX/IECEx		
Certification digit in type code 1		 II 2 GD Ex de IIC T* Gb  II 2 GD Ex tb IIIC T** Db
Certification digit in type code 3		 II 2 GD Ex ib IIC T* Gb  II 2 GD Ex tb IIIC T** Db
Certification digit in type code 5		 II 2 GD Ex de ib IIC T* Gb  II 2 GD Ex tb IIIC T** Db
Gas/dust temperature class		
Maximum ambient temperature		Ta +55°C Ta +40°C
Applications with 5°K internal rise		T5 / T95°C T6 / T80°C
Applications with 10°K internal rise		T4 / T130°C T6 / T80°C
Applications with 15°K internal rise		T4 / T130°C T5 / T95°C
When Schmersal controls fitted		T4 / T130°C T4 / T130°C
Refer to the enclosure certification label for confirmation		
Minimum ambient temperature		-40°C (-25°C / 0°C when fitted with Schmersal controls) -50°C with specific equipment options
IP Rating		IP 66 (IP 65 when fitted with Schmersal controls)

(F)XL*****.CS (formerly .CP)	Refer to type code builder in chapter „Typecodes“	
GL*****.CS (formerly .CP)	Refer to type code builder in chapter „Typecodes“	
Maximum internal power dissipation (MDP)	Dependent on enclosure size and application internal rise – see certification label	
Mechanical		
XL/FXL types		
Material		
Stainless steel models	316L	
Mild steel models	CR4	
Finish		
Stainless steel models	Electropolished	
Mild steel models	Powder coated	
GL types		
Material	Glass reinforced polyester	
Finish	As moulded	
All types		
Cover screw torque	2 Nm	
Entry threadform	Refer to Customer Specific Drawing produced at time of ordering	
Electrical		
Maximum voltage	Dependent on terminals & equipment fitted – see certification label	
Maximum current	Dependent on terminals, cable & equipment fitted – see certification label	
Conformity	EN 60079-0: 2012 EN 60079-7: 2007 EN 60079-31: 2009 EN 60079-1: 2007 EN 60079-11: 2007 EN 60529	

Dissipation of copper cables in W/m

	Current (A)					
Cable CSA	1	2	4	6	10	16
1 mm ²	0.0168	0.0672	0.269	0.605	1.68	4.3
2.5 mm ²	0.00672	0.0269	0.108	0.242	0.672	1.72
4 mm ²	0.0042	0.0168	0.067	0.151	0.42	1.08
6 mm ²	0.0028	0.0112	0.045	0.101	0.28	0.717



THORNE &
DERRICK
INTERNATIONAL

Thorne & Derrick
+44 (0) 191 410 4292
www.heatingandprocess.com

Typecodes
(F)XL*.CS Typecode:

Type code / model number									
Enclosure type									
FXL	metal enclosure with return flange								
XL	metal enclosure								
:	Material								
:	M	mild steel							
:	S	stainless steel							
:	:	Enclosure size							
:	:	nn	enclosure size from standard range						
:	:	:	Type of explosion protection						
:	:	:	1	Ex de, Ex tb					
:	:	:	3	Ex ib, Ex tb					
:	:	:	5	Ex de ib, Ex tb					
:	:	:	:	Gland plate at face(s)					
:	:	:	0	none					
:	:	:	1	face B					
:	:	:	2	faces A, B					
:	:	:	3	faces B, C, D					
:	:	:	4	faces A, B, C, D					
:	:	:	:	Enclosure depth					
:	:	:	:	standard depth					
:	:	:	D	increased depth					
:	:	:	:	Type of solution					
:	:	:	:	CS	control station				
:	:	:	:	:	Optional digit				
:	:	:	:	n	counter				
:	:	:	:	:	Item number				
:	:	:	:	:	Yxxxxxx				
						.CS			
							-Yxxxxxx		

GL*.CS Typecode:

Type code / model number									
Enclosure type									
GL	glass fiber reinforced polyester GRP								
:	Enclosure size								
:	nn	enclosure size from standard range							
:	:	Earth continuity plate							
:	:	0	none						
:	:	1	galvanized steel						
:	:	2	brass						
:	:	3	stainless steel						
:	:	:	Type of explosion protection						
:	:	:	1	Ex de, Ex tb					
:	:	:	3	Ex ib, Ex tb					
:	:	:	5	Ex de ib, Ex tb					
:	:	:	:	Enclosure depth					
:	:	:	:	standard depth					
:	:	:	D	increased depth					
:	:	:	:	Type of solution					
:	:	:	:	CS	control station				
:	:	:	:	:	Optional digit				
:	:	:	:	n	counter				
:	:	:	:	:	Item number				
:	:	:	:	:	Yxxxxxx				
GL						.CS			
							-Yxxxxxx		



THORNE &
DERRICK
INTERNATIONAL

Thorne & Derrick
+44 (0) 191 410 4292
www.heatingandprocess.com