

General Specifications for SRH2-20" Fan Size Hydronic Unit Heater

Notes

1. Pressure/Temperature Ratings

Pressure = 150 psig (1034 kPa)
 Temperature = 550°F (288°C)
 MDMT = -20°F (-29°C)

2. Materials

Cabinet: 14 Ga. Yellow Epoxy/Polyester Powder Coated
 Core: Carbon Steel with Copper-free Aluminum Fins
 Louvers: Anodized Extruded Aluminum

3. Fluid Connections

2 in. FNPT
 Optional Thread-on 2 in. MNPT (shipped loose)
 Optional 2 in. FNPT CL300# flange (shipped loose)

4. Mounting

5/8 in. - 11 UNC diameter holes on top
 (4 places)

5. Fan

Spark-proof three-blade aluminum

6. Fan Guard

Split design with close wire spacing. A 3/8 in.
 (9.5 mm) diameter probe will not enter


7. Ex-Proof Motors

Class I, Divisions 1 & 2, Groups C & D
 Class II, Divisions 1 & 2, Groups F & G
 Temperature Code T3B


- ♦ Thread-on fittings. Shipped loose and must be installed on site. C3 connection also includes C2 connection.
- † Standard Marathon NEMA ex-proof motor is suitable for Class I & II, Div. 1 & 2, Groups C, D, F & G; T3B. Ensure equipment meets the requirements of your hazardous location.
- * Other voltages/frequencies available upon request. Longer lead times may apply. Contact factory.
- ▶ NEMA motors are designed to be operated at rated voltage with tolerances of ± 10%. If the motor is marked 208-230V the tolerance must be calculated from 230V. If motor is marked 230V it is still suitable for 208V operation but the tolerance must be calculated from 230V. For 3-phase motors the line-to-line full load voltage must be balanced within 1%.

Fan Size	20
Dim.	Inches (mm)
A	19.49 (495)
B	4.02 (102)
C	2.40 (61)
D	24.29 (617)
E	10.51 (267)
F	5.75 (146)
G	2.50 (63.5)
H	3.62 (92)
I	25.96 (659)
J	17.00 (432)
K	1.38 (35)
L	22.57 (573)
M	30.48 (774)

Note: Inlet and Outlet coupling connection locations can be reversed in the field by rotating the core.

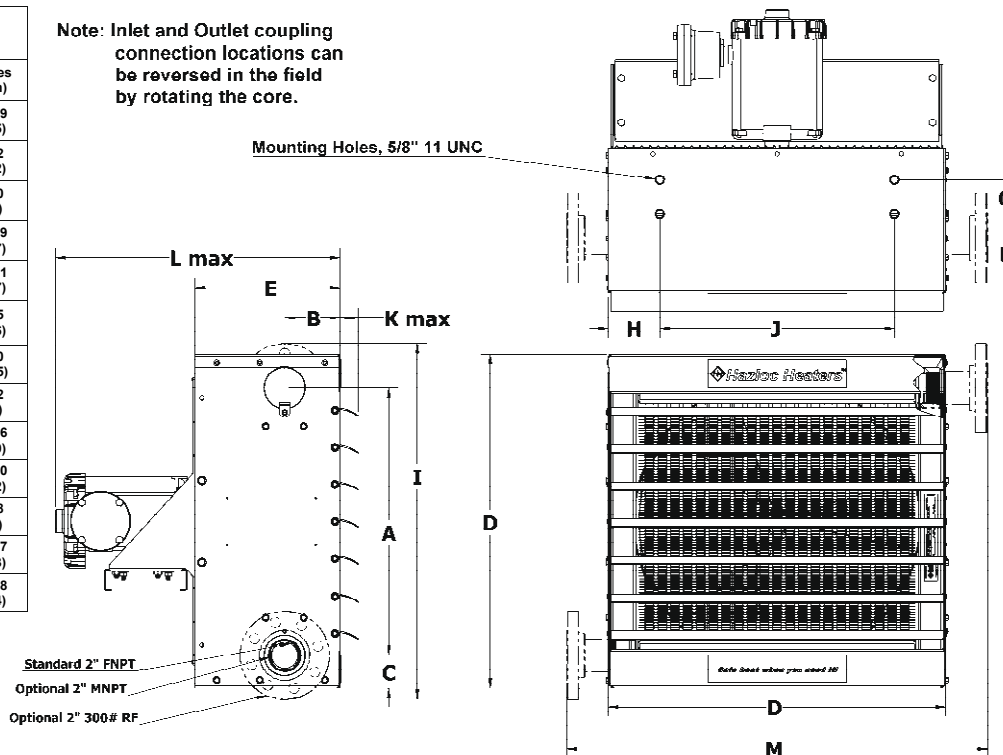

Heater Model Code and Option Codes

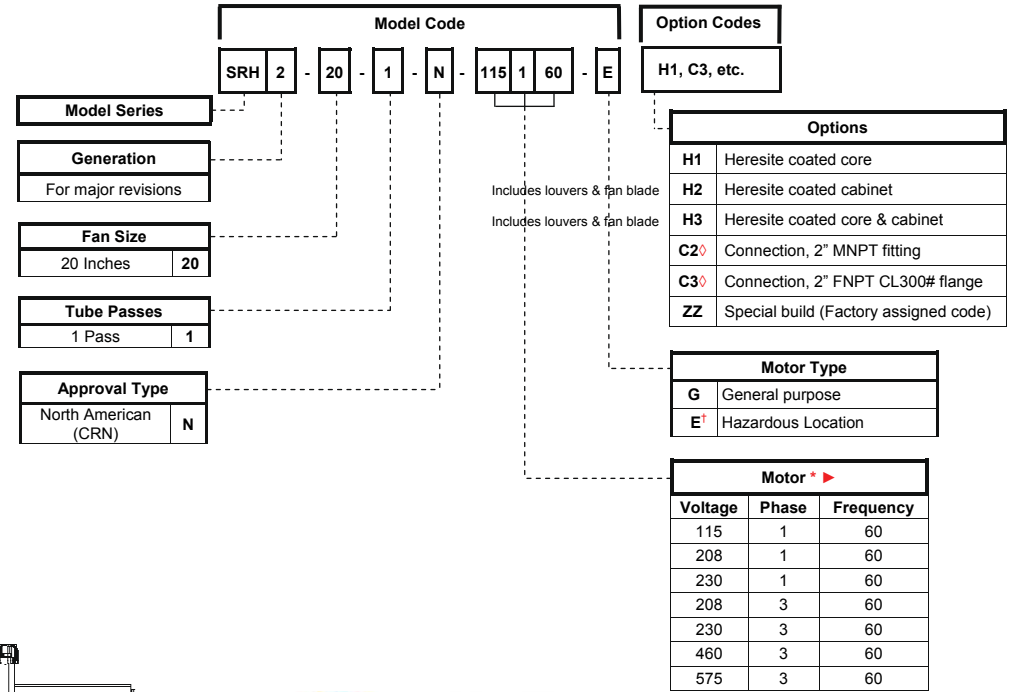

THORNE & DERRICK
 INTERNATIONAL
 Thorne & Derrick
 +44 (0) 191 410 4292
 www.heatingandprocess.com

Special Requirements/Notes:

Approval Drawing	SRH2-20" Fan Size Heater
July 12, 2018	Version 1.0
Hazloc Heaters Inc.	Calgary, Alberta

